




REVISION NO. 9

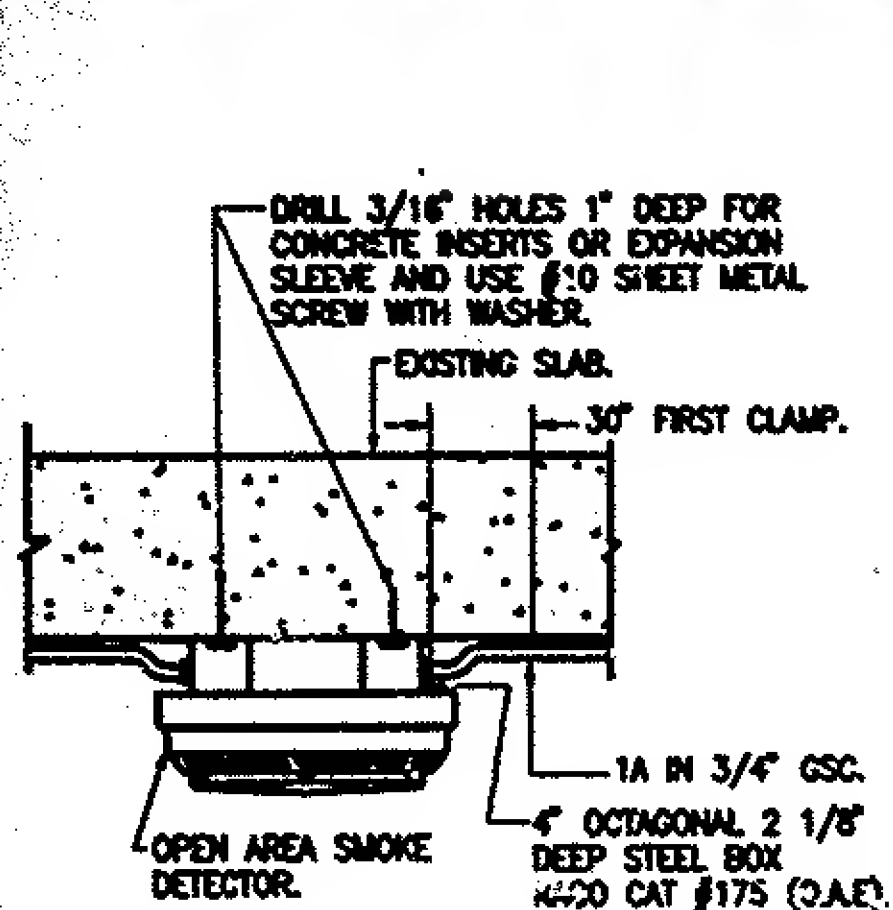


**SMOKE DETECTOR INSTALLATION
DETAIL "A" (FOR OPEN CEILING)**
N.T.S.

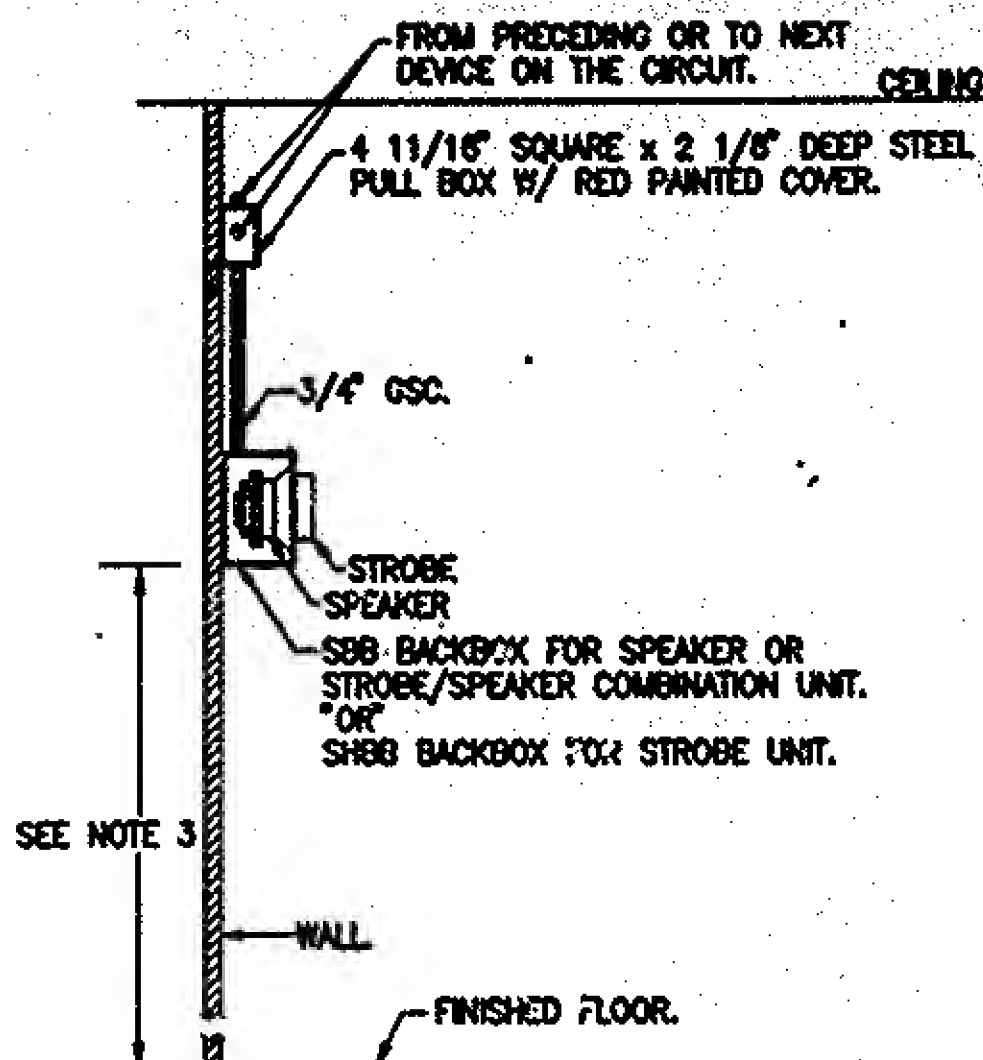


**TYPICAL WALL MOUNTED STROBE, SPEAKER,
STROBE/SPEAKER INSTALLATION DETAIL "B"**
N.T.S.

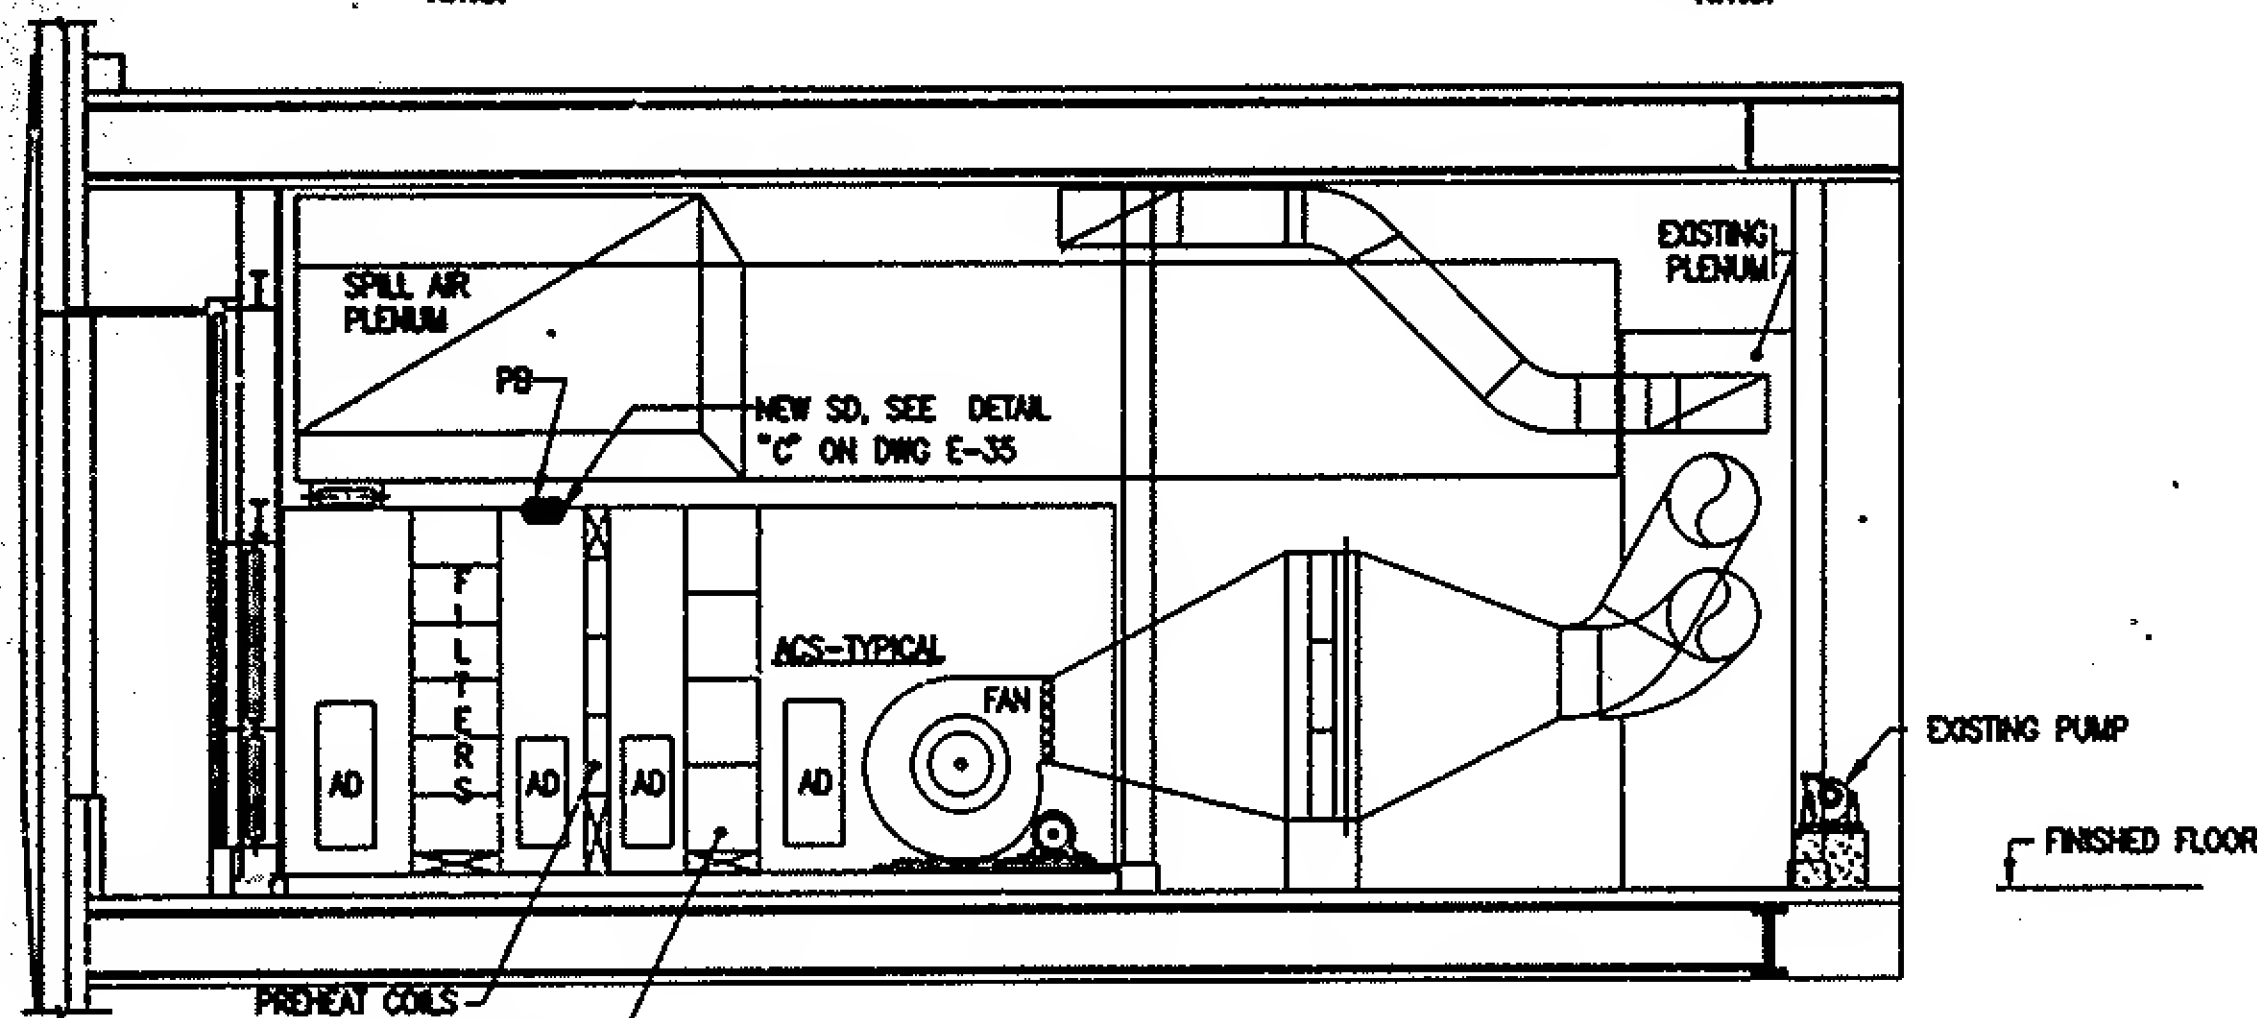


**LOCATION OF ACS AREA SMOKE
DETECTOR TYPICAL DETAIL "C"**
N.T.S.

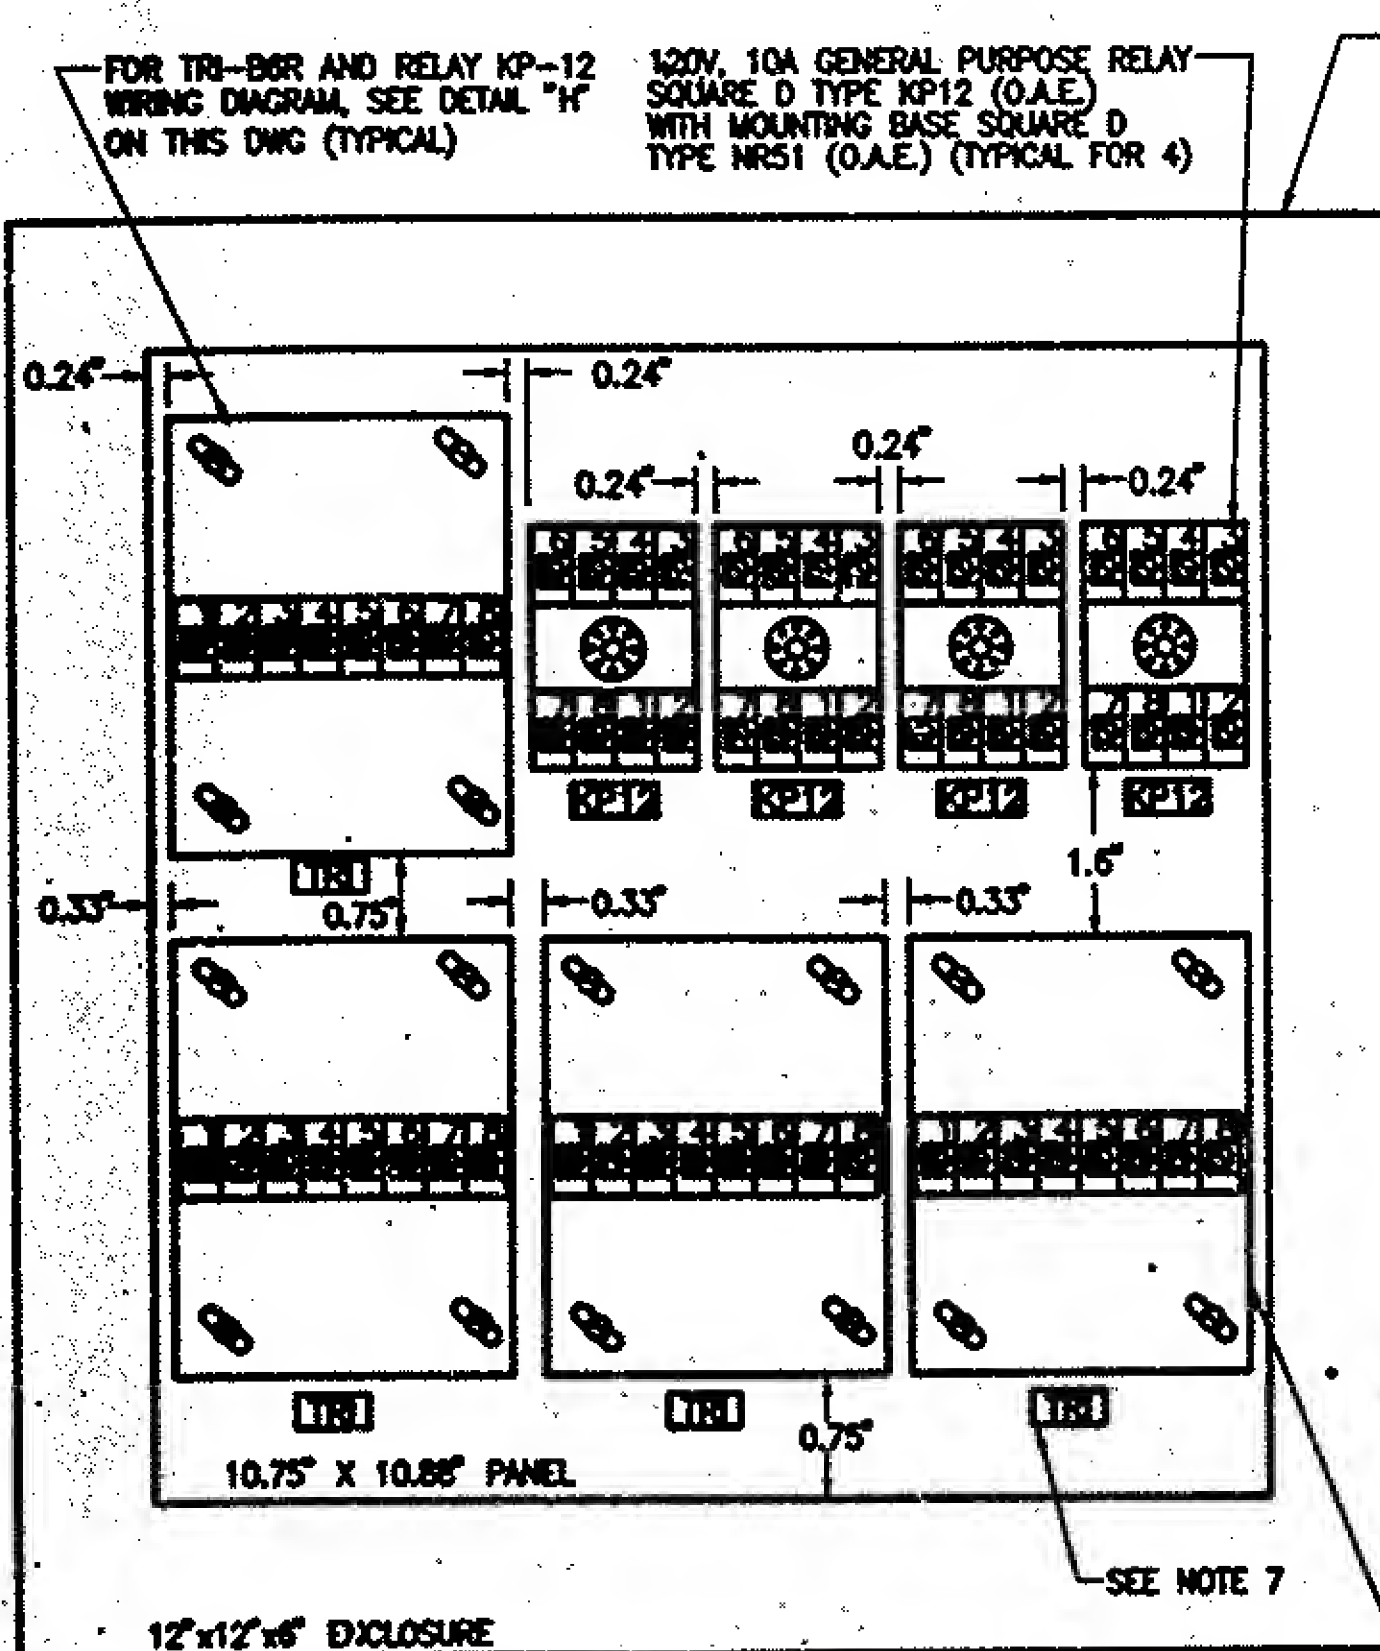


**TRI-B6R AND KP-12 RELAYS
MOUNTING DETAIL "G"**
N.T.S.

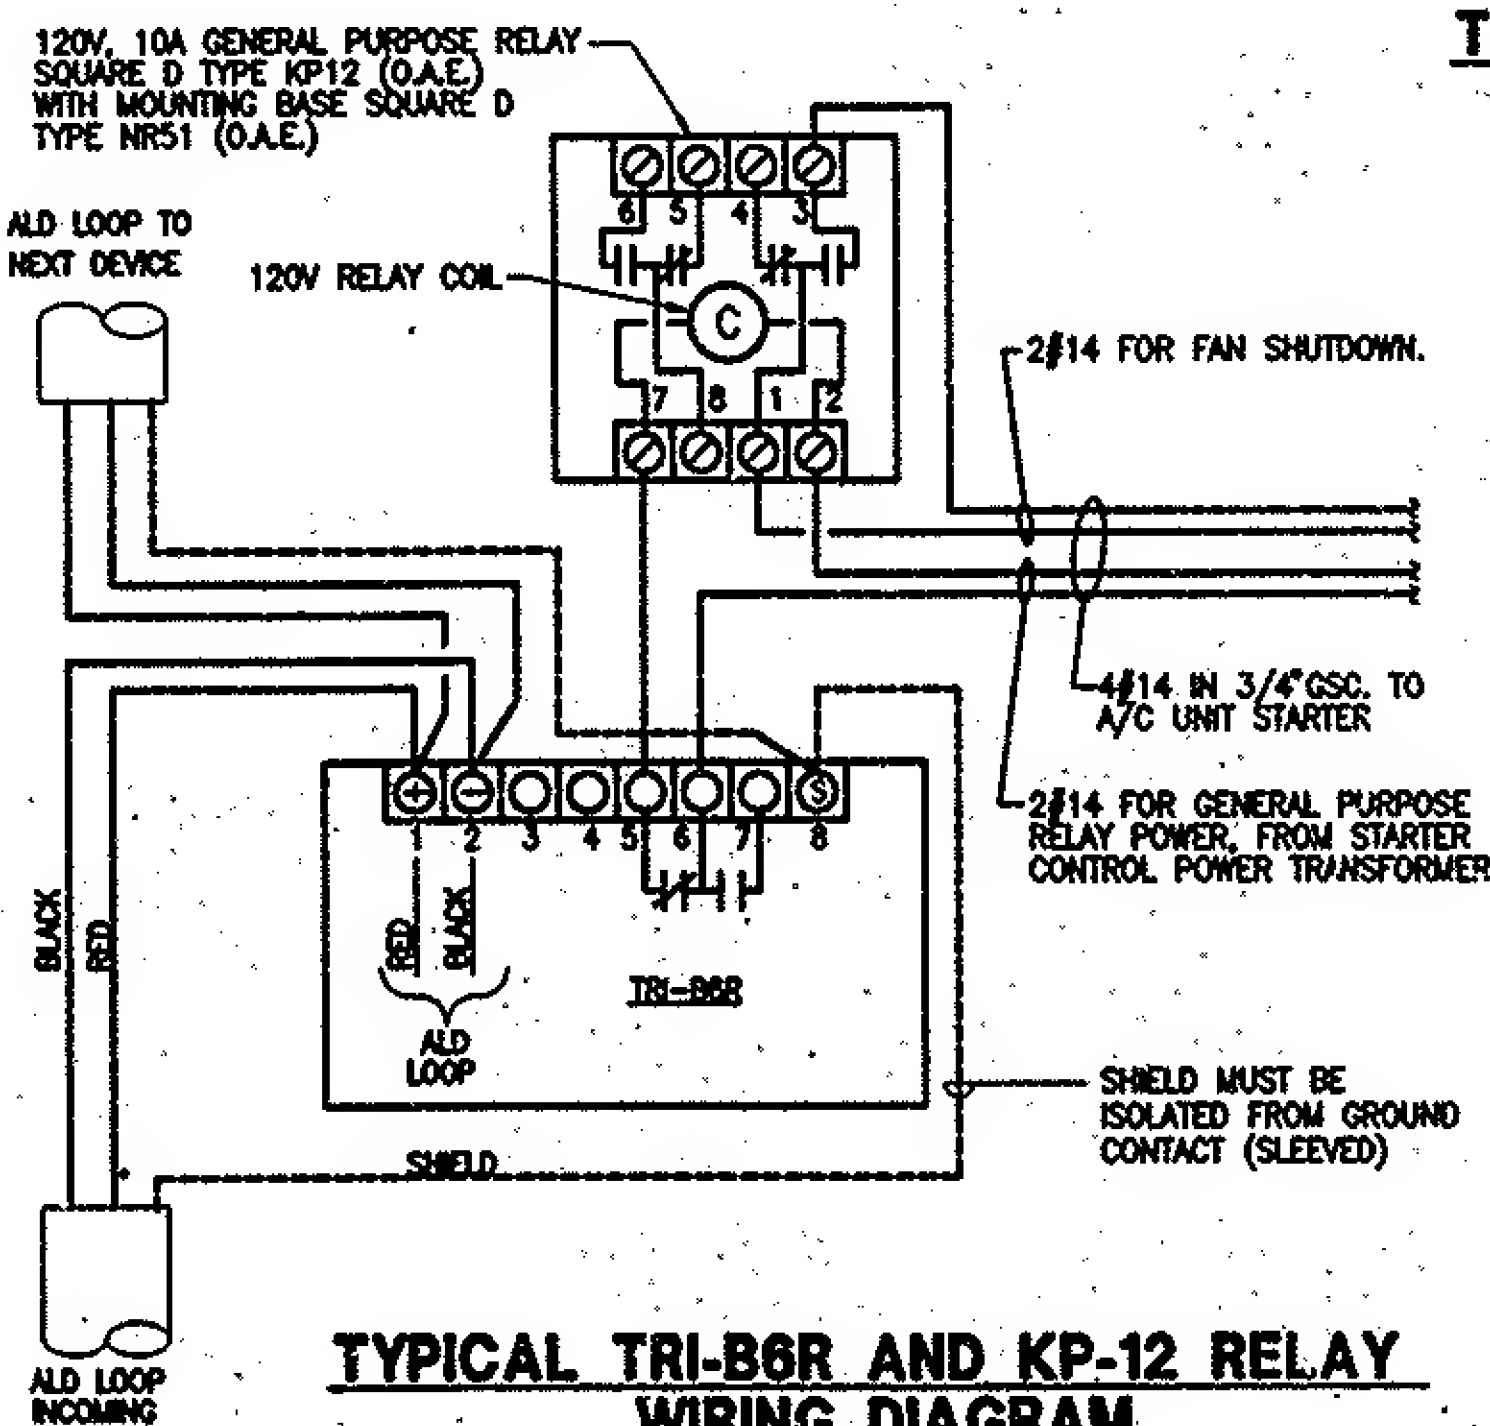


**TYPICAL TRI-B6R AND KP-12 RELAY
WIRING DIAGRAM
DETAIL "H"**
N.T.S.

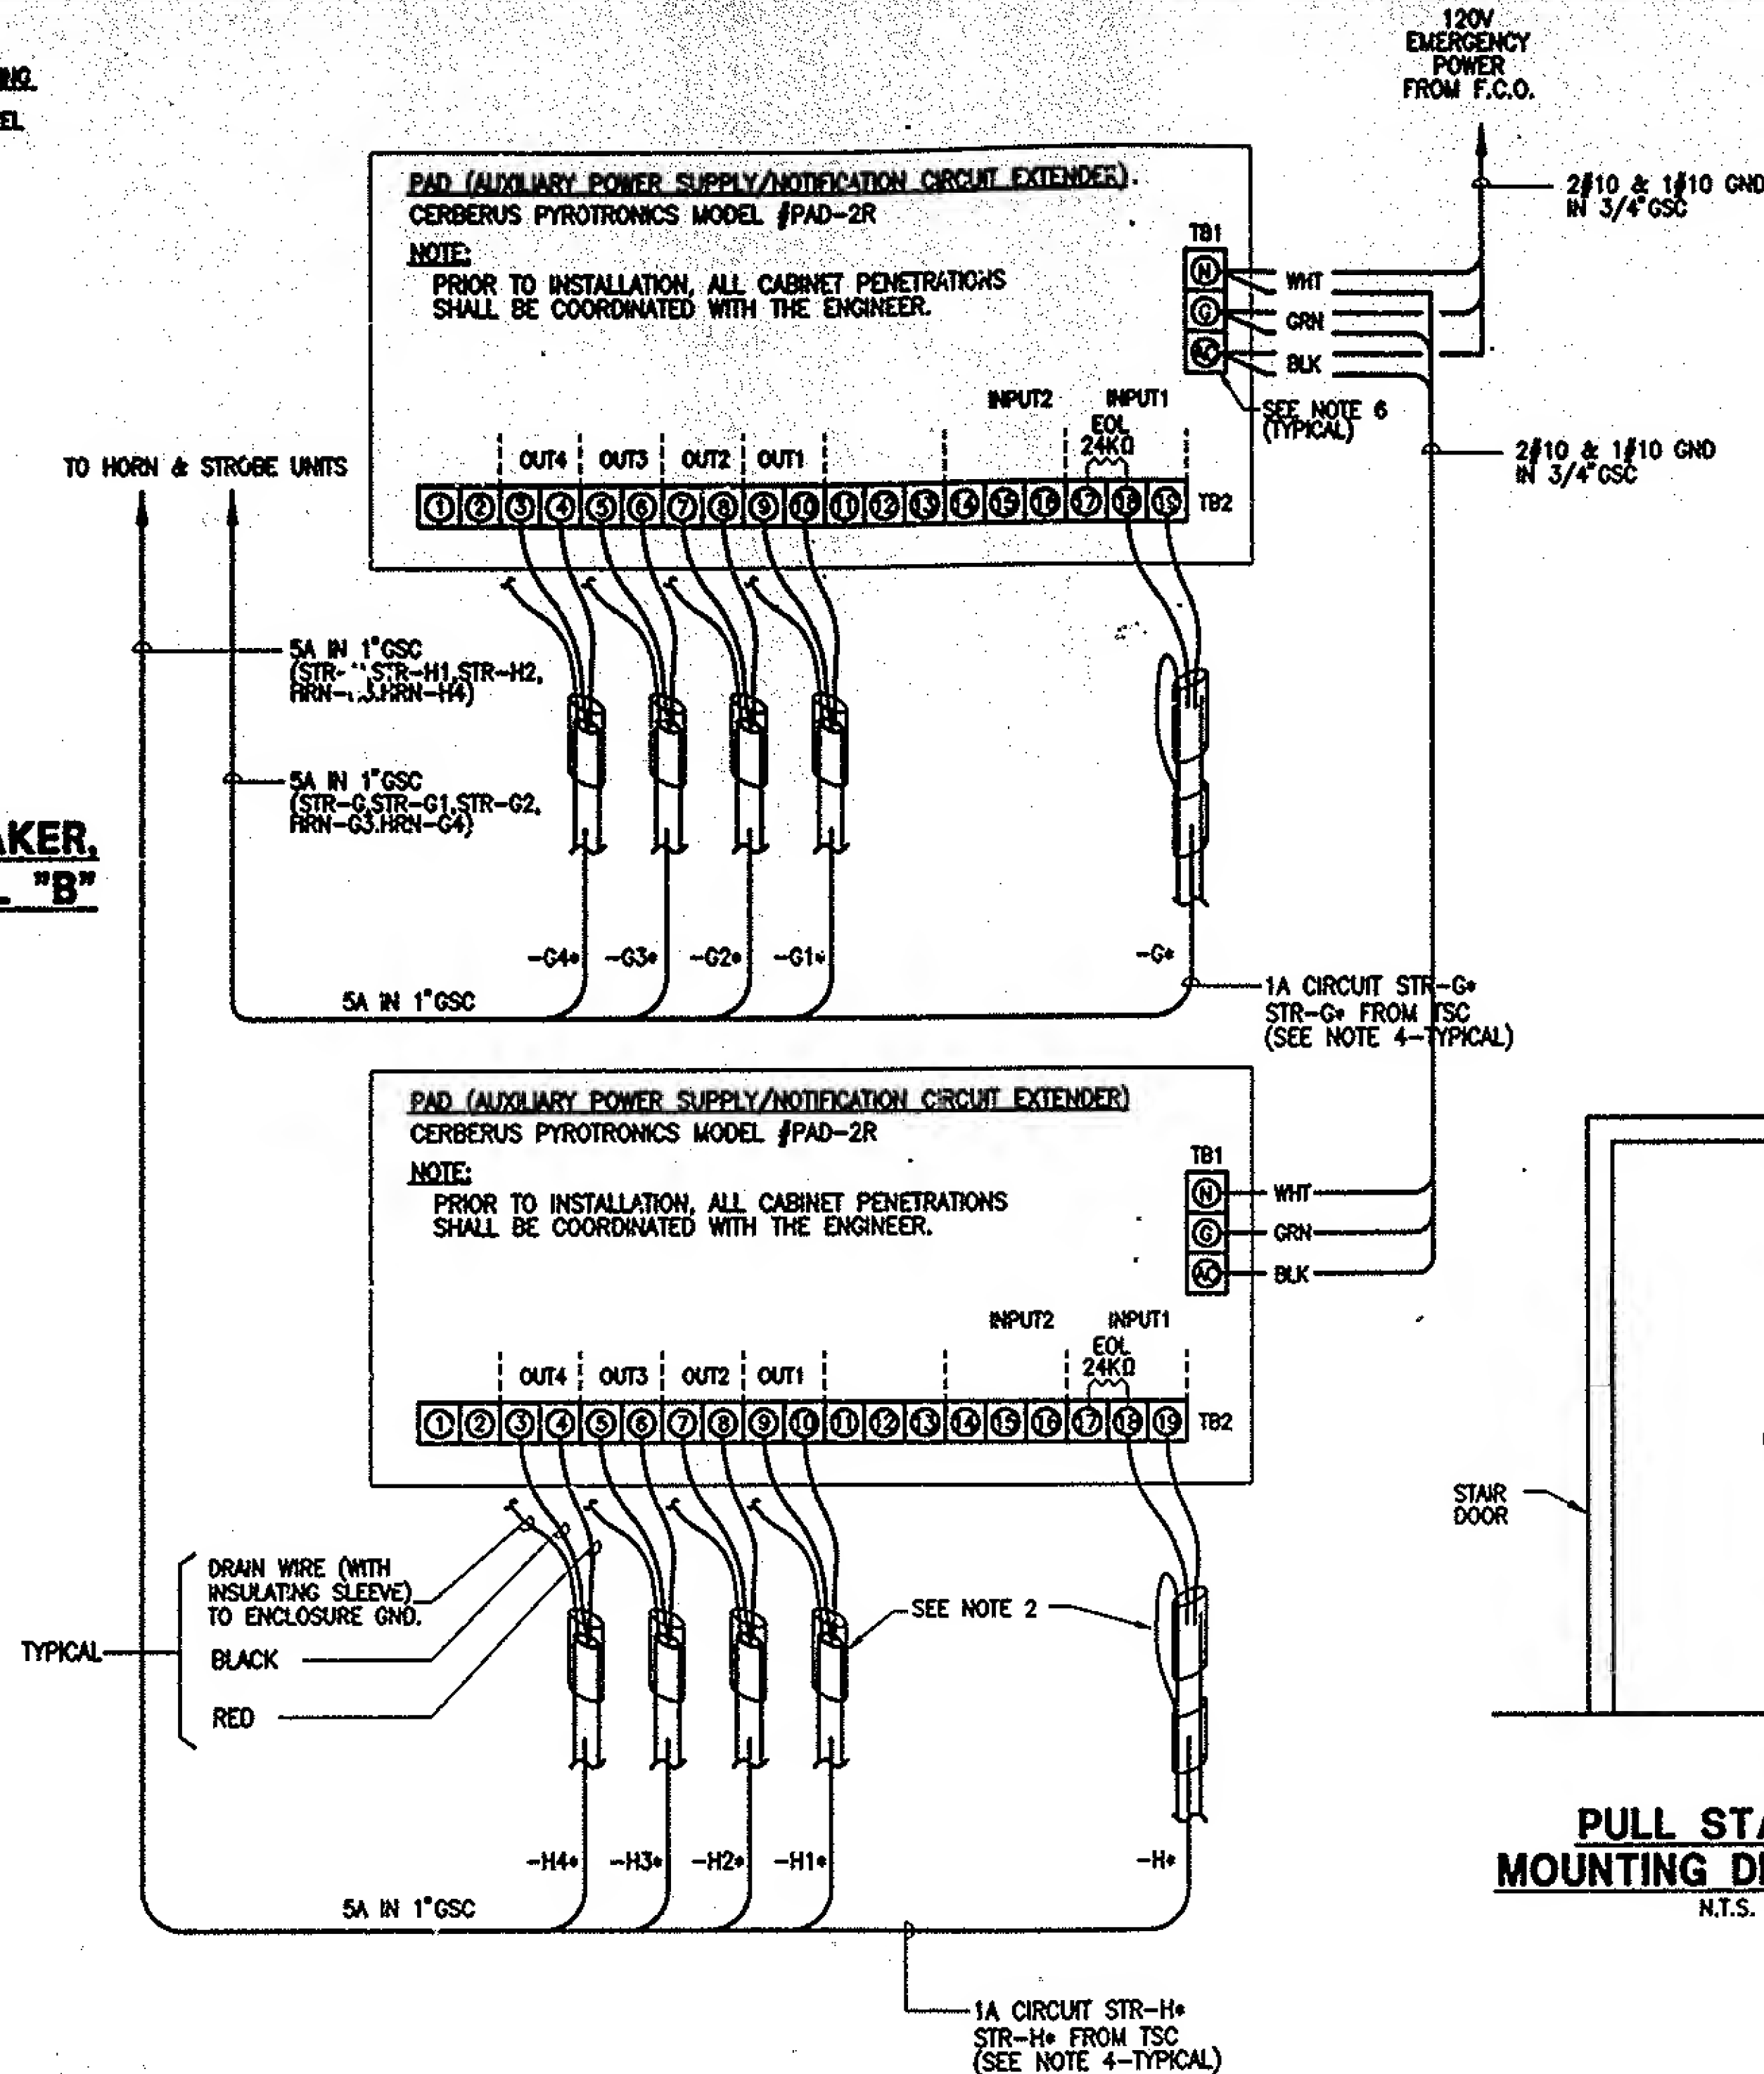

**TYPICAL PAD WIRING DIAGRAM
DETAIL "D"**
N.T.S.

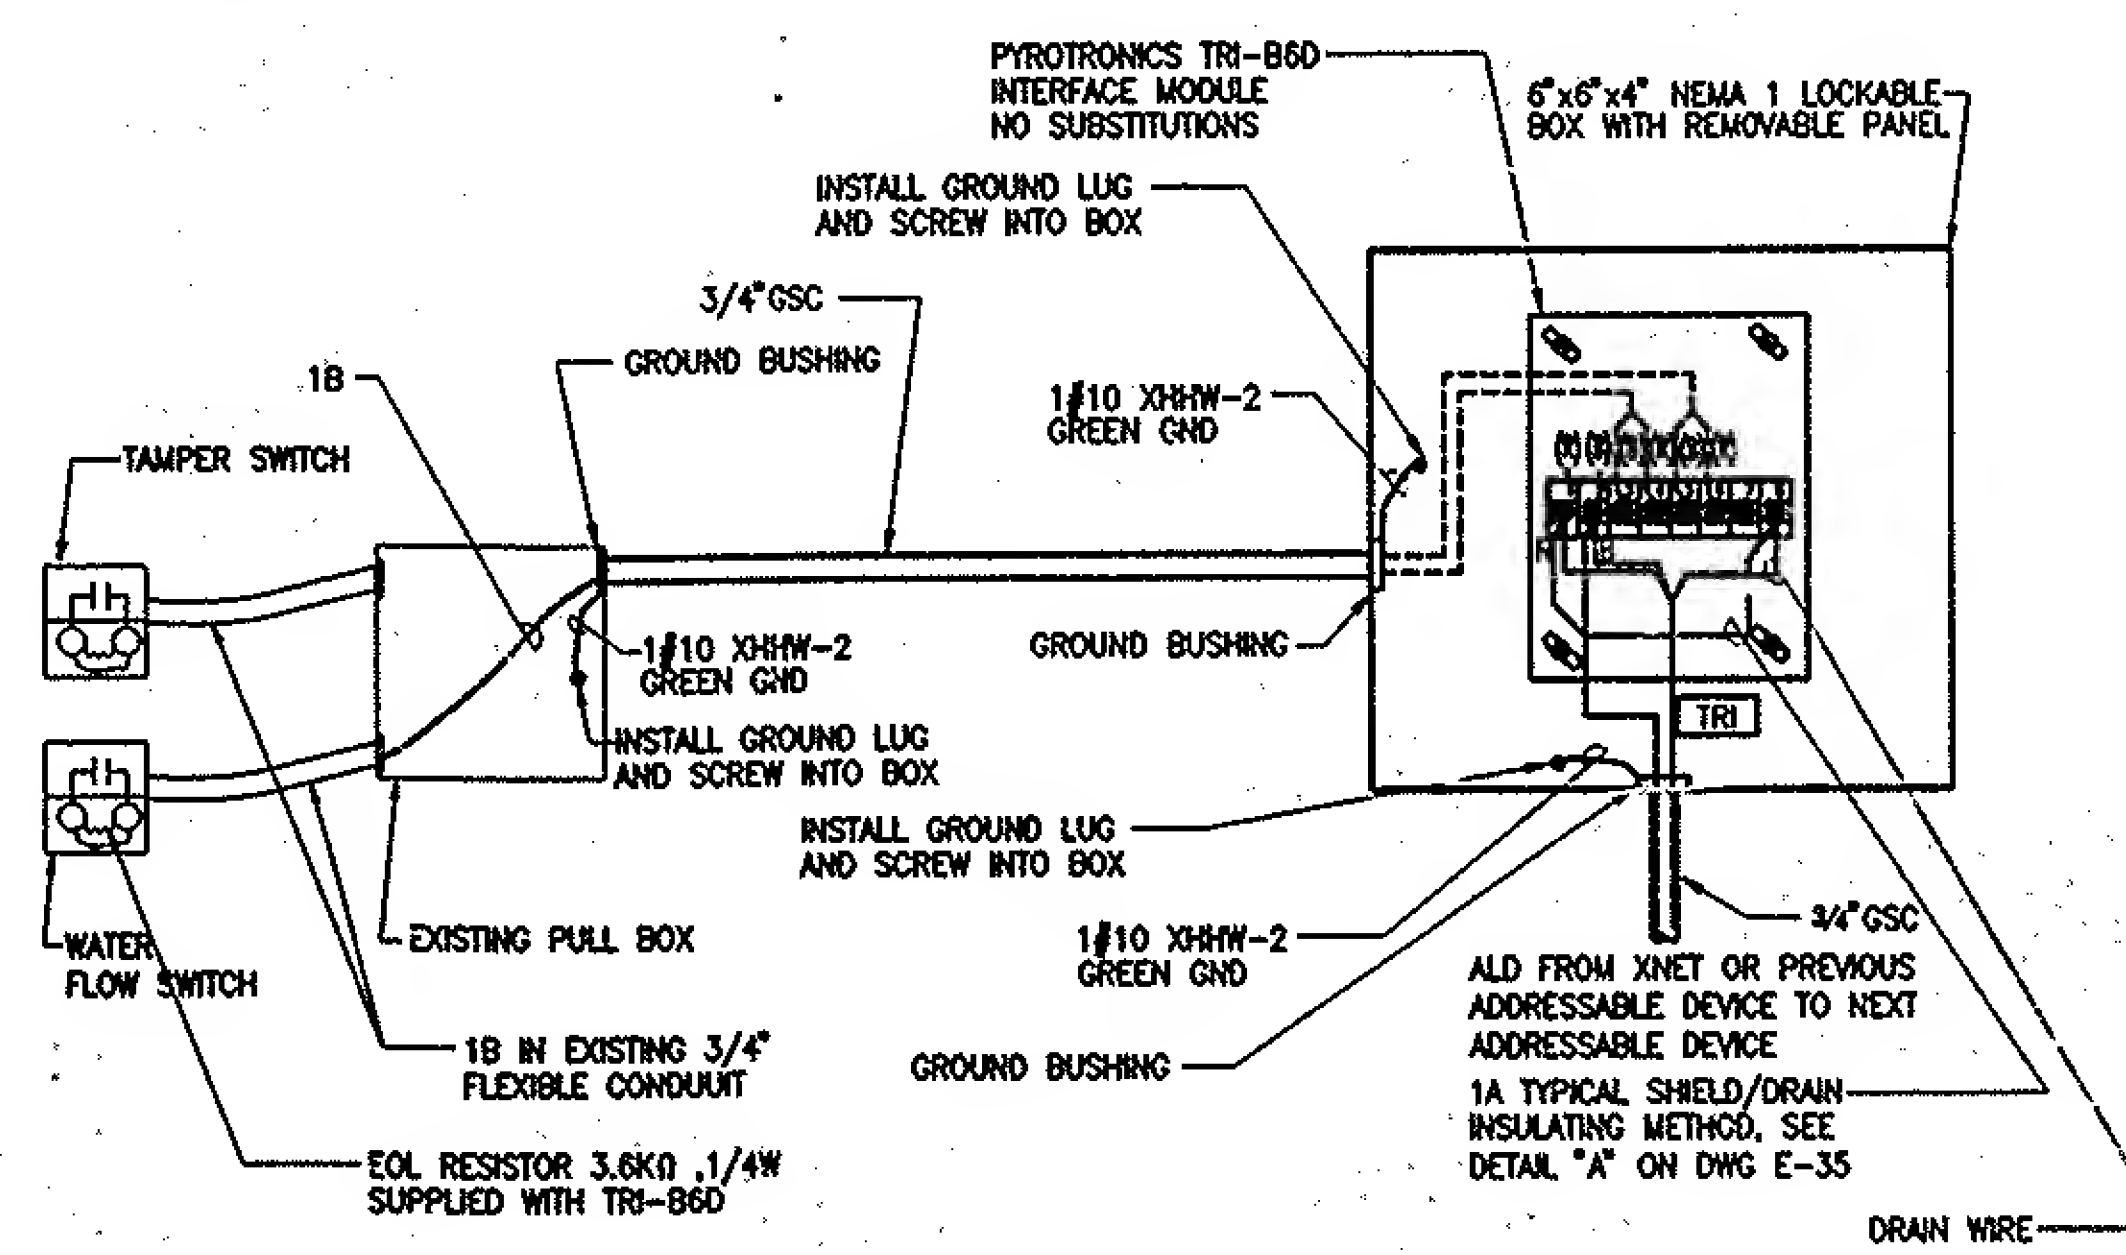

**TRI (TRI-B6D) BOX
DETAIL "I" (SEE NOTE 8)**
N.T.S.

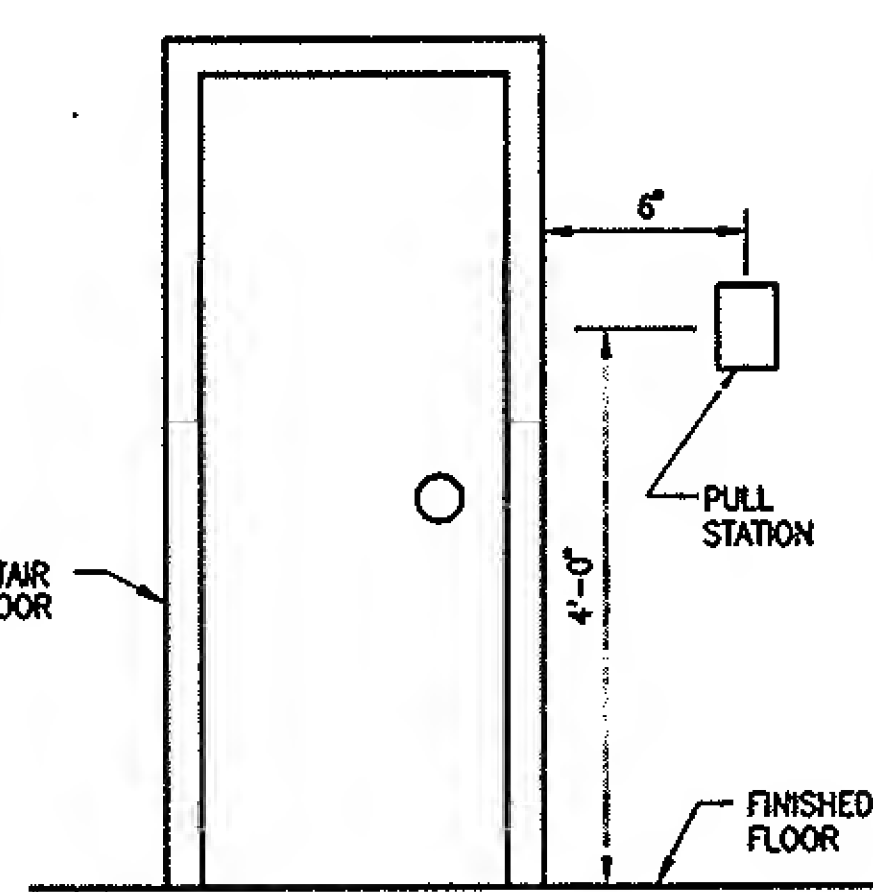

**PULL STATION
MOUNTING DETAIL "E"**
N.T.S.